

# MULTIPLE BED REGENERATIVE ADSORPTION CYCLE USING THE MONOLITHIC CARBON – AMMONIA PAIR

Dr. R.E. Critoph

University of Warwick, School of Engineering, Coventry CV4 7AL, UK

## ABSTRACT

*A refrigeration / heat-pump system based on a number of simple tubular adsorption modules is described. A single module is comprised of a generator and a receiver/condenser/evaporator. A single generator consisting of a 12.7 mm stainless steel tube lined with 2.6 mm of monolithic active carbon has been manufactured. A complete module has been tested in a simple rig, which subjects it to alternating hot and cold airstreams, desorbing and adsorbing ammonia. A complete system, consisting of 32 modules has been modelled in detail and its predicted performance is presented. Key parameters have been varied and their effect on the performance discussed.*

## RÉSUMÉ

*Un système thermique réfrigérateur/pompe à chaleur basé sur un certain nombre de simples modules tubulaires à adsorption est décrit. Un simple module comprend un générateur et un récipient/condenseur/évaporateur. Un générateur, constitué d'un tube en acier inoxydable (diamètre extérieur 12.7 mm) à parois interne recouverte d'une couche de carbone actif monolithique d'environ 2.6 mm d'épaisseur, est fabriqué. Un module complet a été testé sur un simple banc d'essais qui génère alternativement des courants d'air chaud et froid pour désorber et adsorber l'ammoniac respectivement. Un système complet comprenant 32 modules a été modélisé et les prédictions de ces performances sont présentées dans cet article. Une étude des paramètres dudit modèle permet de mettre en évidence l'influence de ses derniers sur les performances du système.*

**KEYWORDS** *Simulation, adsorption, carbon, ammonia, heat pump, refrigeration, regenerative*

## 1. INTRODUCTION

It is well known that the major challenges for adsorption cycles are:

- To improve heat transfer in adsorbate beds, thereby reducing size and cost.
- To improve regenerative heat transfer between beds, thereby increasing COP.

Current progress is reviewed by Meunier [1]. Bed conductivities have been improved from  $0.1 \text{ W m}^{-1} \text{ K}^{-1}$  [2,3] to  $0.4 \text{ W m}^{-1} \text{ K}^{-1}$  for monolithic carbons [4] and  $5 \text{ W m}^{-1} \text{ K}^{-1}$  for graphite composites [5]. Cooling and heating COP and the SCP of a range of sorption machines are given in [6]. It is not possible to generalise about them, since many different applications were studied, but it is probably true to say that in air conditioning applications adsorption machines need to be improved if they are to compete with multiple-effect Lithium Bromide absorption systems. The ideas presented below aim at both improving the efficiency and reducing the cost of adsorption refrigeration and heat pumping. They are the subject of a patent [7].

## 2. CONCEPT

In order to achieve good regeneration between adsorption and desorption it is necessary to either employ some form of thermal wave [8,9] or many beds [10]. This study examines the possibility of using many simple modular beds in an arrangement that allows effective heat transfer

between them. A single module is shown schematically in Figure 1. It is a tube having a sorption generator at one end and a combined evaporator and condenser at the other. The first such module that we have made has a stainless steel tube 12.7 mm in diameter and 500 mm long containing the generator. It is lined with a 3 mm layer of monolithic carbon provided by Sutcliffe Carbons Ltd. The carbon shape is formed within the tube and so the heat transfer between steel and carbon is very high. The other end of the module is a receiver for the liquid adsorbate; ammonia in our work. The optional wire gauze acts as a wick to keep the liquid in contact with the wall. The adiabatic section separates the generator and receiver, reducing longitudinal conduction between them. In the current design with 0.25 mm wall thickness tube, a 20mm 'adiabatic' length reduces mean longitudinal conduction to less than 1W. This could be further reduced if necessary.

Heat may be transferred to or from the generator and receiver by passing air or any other fluid across them. In the case of air, fins can enhance the heat transfer. In desorption, the generator is heated and desorbed refrigerant condenses in the receiver, which is cooled. In adsorption the generator is cooled and heat is provided to boil the refrigerant in the receiver. The whole module is the very simplest type of adsorption refrigerator or heat pump.

It is possible to combine many such modules in an assembly that allows regenerative heating between them. Figures 2 and 3 show one possible way of doing this in

schematic form. In this example the machine is an air-to-air heat pump or air conditioner. 16 modules are shown, arranged in a cylindrical shell. All rotate about the central axis (X in Figure 2) typically completing one revolution in ten minutes. Air is blown over the tubes, counterflow to their direction of motion and exchanging heat with them. Seals prevent the air from travelling directly between the adsorbing and desorbing zones but allow the tubes to pass through when necessary. Consider the path of a single tube beginning at position 1 in Figure 3. The carbon is at its coldest, perhaps 50°C and has maximum concentration. As it moves clockwise through the annular duct it is heated by air flowing in the opposite direction. If the 'thermal mass flow rate' of the generator is approximately the same as that of the air, then the desorption section acts like a counterflow heat exchanger with capacity ratio close to unity. In reality, the effective specific heat of the carbon varies during a cycle but it is still possible to balance the flow rates quite well. The result is that by the time the module reaches the end of the desorption section it is perhaps at 200°C. Whilst the carbon is heated it desorbs ammonia which condenses in the receiver section of the module. In an air conditioning application, a stream of ambient temperature air cools the receiver section. A similar process occurs in the adsorbing section, but with evaporation occurring in the receiver, which cools the airstream passing over it. In the course of cooling down, the generator tubes heat the stream of ambient air induced at position 2. This pre-heated air is removed from the annular duct at position 3 and heated by an external high grade heat source before being re-introduced to the duct at position 4.

The greater the number of modules, the better the approximation to a continuous process with counterflow regeneration of heat.

The advantages of the system are the absence of refrigerant valves and complex or expensive heat exchangers. Potential problems might include the sealing mechanism to direct the air flows and possible degradation of the carbon due to thermal shock.

### 3. INITIAL EXPERIMENTATION

Previous experience with monolithic carbon [11] suggested that monolithic carbon should be proof against the thermal cycling and could be made to adhere strongly to the tube wall. A manufacturing technique was devised and a 500 mm length of 12.7 mm outside diameter 0.9 mm wall thickness stainless steel tube was lined with 3 mm of active carbon, as shown in Figure 4. A simple test rig was built which subjected the generator to alternating flows of hot (150°C) and ambient air whilst the receiver was kept in a flow of ambient air. An optional glass receiver allowed observation of the quantity of liquid ammonia building up or boiling. Repeated heating and cooling for tens of cycles showed no tendency for the carbon to break up and drop into the receiver. This was encouraging, but obviously in a real system there will be

many thousands of cycles and further testing is necessary.

### 4. SIMULATION MODEL

A simulation model has been written in Matlab™ which is described fully in [12]. The example presented is one that gives reasonable performance but is not optimised in many respects. There are many design parameters and many different functions (COP, SCP, economics etc.) that may be optimised and so the concept of a single optimum design is not necessarily useful.

The key design parameters and operating conditions chosen are in Table 1.

After four revolutions the COP in cooling is 0.60 and the COP in heating is 1.53 rather than 1 + Cooling COP. The disparity is due to the fact that conditions at the start of the final revolution are not precisely those at the end. The major performance indicators are given in Table 2.

The behaviour of the system is shown in Figure 5, which shows the mean carbon temperature of 4 of the 32 modules (Nos. 1,9,17,25) with time over four complete cycles of 864 s. It shows how the starting transients develop and then damp towards regular cyclic behaviour. The transient form is a result of the constant heater outlet temperature – a constant power heater would produce a different transient.

Figure 6 shows the heat input or output of an individual module during the final revolution of 864 s. It is close to 1000 W kg<sup>-1</sup> for most of the cycle.

### 5. KEY PARAMETERS AND THEIR EFFECT ON PERFORMANCE

There are over one hundred parameters input to the simulation but the effect of five major ones are illustrated here: Thermal capacity ratio, number of modules, temperature of air leaving the heater, generator heat transfer coefficient and the evaporator inlet temperature. The results are shown in Table 3.

The capacity ratio effect is illustrated by varying the generator air duct velocity. In the base case it is 1.0 m s<sup>-1</sup> and alternative cases at 1.1 and 0.9 m s<sup>-1</sup> have been simulated. The reduced COP of both cases is shown in Table 3. Similar effects are observed if the rotational speed of the modules is varied.

The variation in COP and SCP with the heater exit temperature is shown in Figure 7. It is noticeable that the COP is comparatively insensitive to heater temperature in the range chosen, although it does have a peak at around 175°C. At higher temperatures, although a little more ammonia can be desorbed, not all of the sensible heat load can be regenerated and COP drops. However, the cooling power rises with increasing heater temperature in a linear fashion. The minimum mean concentration for a heater temperature of 250°C is 3%

whereas for 150°C it is 10%. The variation of performance with heat transfer coefficient over the generator fins is evident from Table 3. At high values of  $h_{generator}$  the effectiveness of a single tube fin is so close to unity that further gains are minor. In reality  $h_{generator}$  is a function of the air speed but is treated as an independent variable here in order to separate the effects on heat transfer and thermal capacity.

The evaporating and condensing temperatures are determined by the air inlet temperatures to the separate evaporators and condensers. The variation is illustrated in Table 3; COP varies linearly from 0.52 to 0.69 as the inlet temperature to the evaporator increases from 10°C to 20°C.

The variation in COP and SCP with the number of tube modules is non-linear over the range chosen. In the limit of one tube there is no regeneration and for an infinite number of tubes there will be maximum regeneration. Assuming the 'mass flow rate' of modules to be constant the SCP will decrease with an increasing number of tubes. Figure 8 shows the variation for 24 to 64 tubes. The improvement in COP at high module numbers is due mainly to the improved regeneration, but also to the reduced temperature lift resulting from the reduced evaporator and condenser load.

## 6. IMPROVED DESIGN

The simulation model has been modified to include fin efficiency, sensible heats of ammonia, the effect of dead volume etc. It has been used to find a good combination of fin size and pitch, air flow rate, and index time. The results are shown in Figure 9.

It can be seen that COP's of 0.85 with a cooling power of 400 W are feasible. A photograph of a module design based on this analysis is shown in Figure 10. Aluminium fins 0.1 mm thick are put on pairs of module tubes 12.7 mm outside diameter and 0.25 mm thick.

The method used to divert the air flows is to use two radially sliding vanes that can move between the modules at positions 1,2 and 3,4 in Figure 2. The vanes can be withdrawn briefly whilst the complete module assembly is indexed from one position to the next. This is convenient in a laboratory rig but a production version would need a more sophisticated mechanism that allowed the modules to move continuously.

## 7. CONCLUSIONS AND FUTURE WORK

A new continuous adsorption refrigeration system has been described which uses a number of simple tubular modules. A single module has been made and tested and a programme written to simulate many modules in a real system. The design has not yet been optimised but a parametric study has revealed the way in which key parameters affect COP and SCP. A 32 module system is under construction.

## 8. ACKNOWLEDGEMENTS

1. Waterlink Sutcliffe Carbons for their support and supply of materials
2. The Engineering and Physical Sciences Research Council for funding this project under grant GR/M65403.

## 9. REFERENCES

- [1] Meunier F. Adsorption heat pump technology: possibilities and limits. Proceedings of the Int. Sorption Heat Pump Conf., Munich, March 1999: 25-35.
- [2] Douss N., Meunier F., Sun L.M. Predictive model and experimental results for a two adsorber solid adsorption heat pump. I & EC Research; 27: 310-316.
- [3] Critoph R.E., Turner L., Heat transfer in granular activated carbon beds in the presence of adsorbable gases. Int. J. Heat and Mass Transfer 1995; 38,(9):1577-1585.
- [4] Critoph R.E., Tamainot-Telto Z. Thermophysical properties of monolithic carbon. Int. J. Heat and Mass Transfer (in press)
- [5] Guilleminot J.J. From pellet to consolidated adsorbent bed. Proceedings of Fundamentals of Adsorption 6, 1998, Ed. F. Meunier, Elsevier.
- [6] Pons M., et al. Thermodynamic based comparison of sorption systems for cooling and heat pumping. Int. J. Refrigeration 1999; 22 (1) 5-17.
- [7] Critoph R.E. UK Patent Application 9922339.8, 'Thermal regenerative compressive device', filed 21 Sep. 1999.
- [8] Critoph, R.E. Forced convection adsorption cycles. Applied Thermal Engineering 1998; 18: 799-807.
- [9] Miles D.J. et al. Gas fired sorption heat pump development. Proceedings of Solid Sorption Refrigeration, Paris, 1992. pub. LIMSI.
- [10] Meunier F. Second law analysis of a solid adsorption heat pump operating on reversible cascaded cycles: application to the zeolite water pair. Heat recovery systems and CHP 1985; 5; 133-141.
- [11] Critoph, R.E., Tamainot-Telto Z., and Davies, G.N.L. Adsorption refrigerator using a monolithic carbon-aluminium laminate adsorbent and ammonia refrigerant. Proceedings of the Int. Sorption Heat Pump Conf., Munich, March 1999: 349-353.
- [12] Critoph, R.E., Simulation of a continuous multiple-bed regenerative adsorption cycle. Int. J. Refrigeration (in press).
- [13] Critoph, R.E., Tamainot-Telto Z. Monolithic carbon for sorption refrigeration and heat pump applications. Applied Thermal Engineering (in press).

[14] International Institute of Refrigeration.  
Thermodynamic and physical properties of  
ammonia. 1981.

## 10. NOMENCLATURE

COP	Coefficient of performance (-)
$h_{generator}$	Heat transfer coefficient of generator tube/fin ( $\text{W m}^{-2}\text{K}^{-1}$ )
SCP	Specific Cooling Power ( $\text{W kg}^{-1}$ adsorbent)
$T$	Temperature (K)
$T_{ads out}$	Mean temperature of air leaving adsorption section over complete cycle ( $^{\circ}\text{C}$ )
$T_{con mean}$	Mean condensing temperature over complete cycle ( $^{\circ}\text{C}$ )

$T_{con out}$	Mean temperature of air leaving condensing section over complete cycle ( $^{\circ}\text{C}$ )
$T_{des out}$	Mean temperature of air leaving desorption section over complete cycle ( $^{\circ}\text{C}$ )
$T_{ev mean}$	Mean evaporating temperature over complete cycle ( $^{\circ}\text{C}$ )
$T_{ev out}$	Mean temperature of air leaving evaporating section over complete cycle ( $^{\circ}\text{C}$ )
$T_{sat}$	Saturation temperature (K)

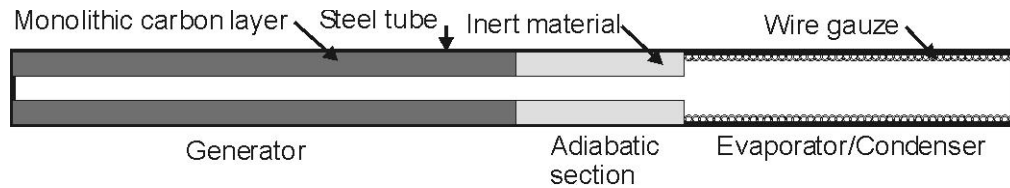


Figure 1: Sorption Module

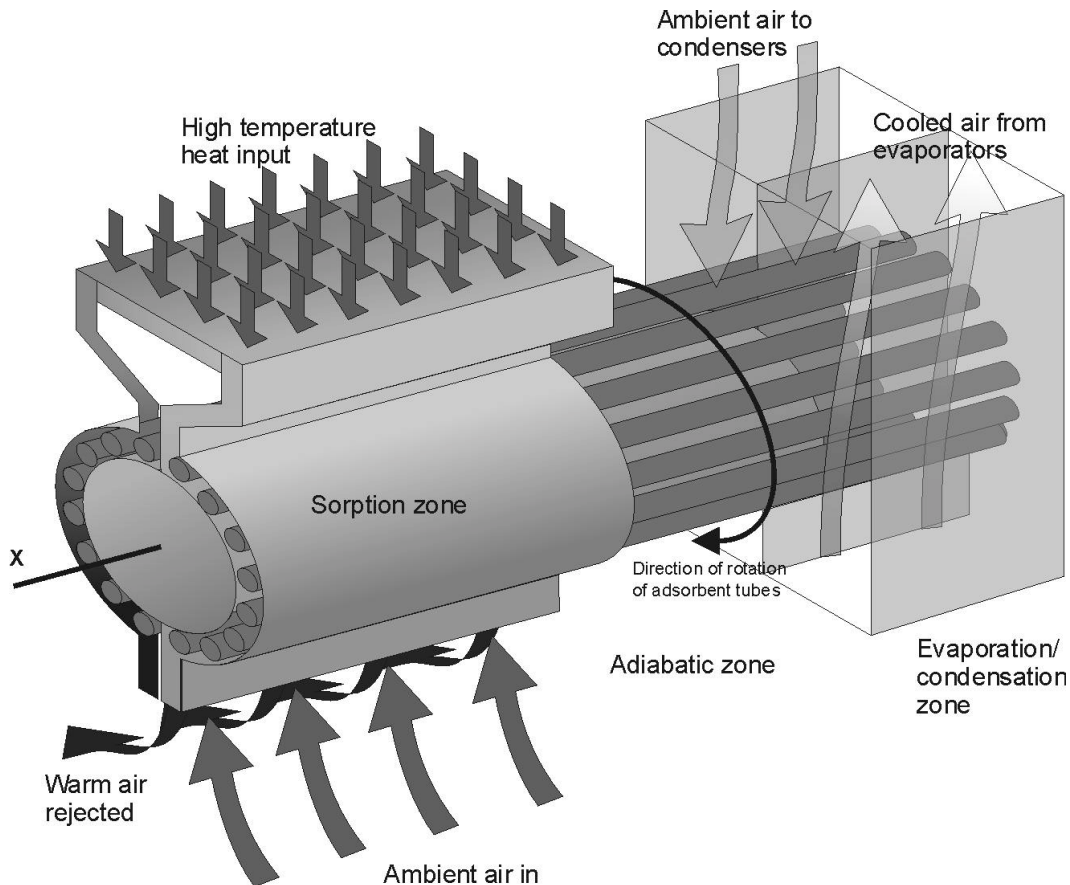


Figure 2: Schematic air to air heat pump / chiller

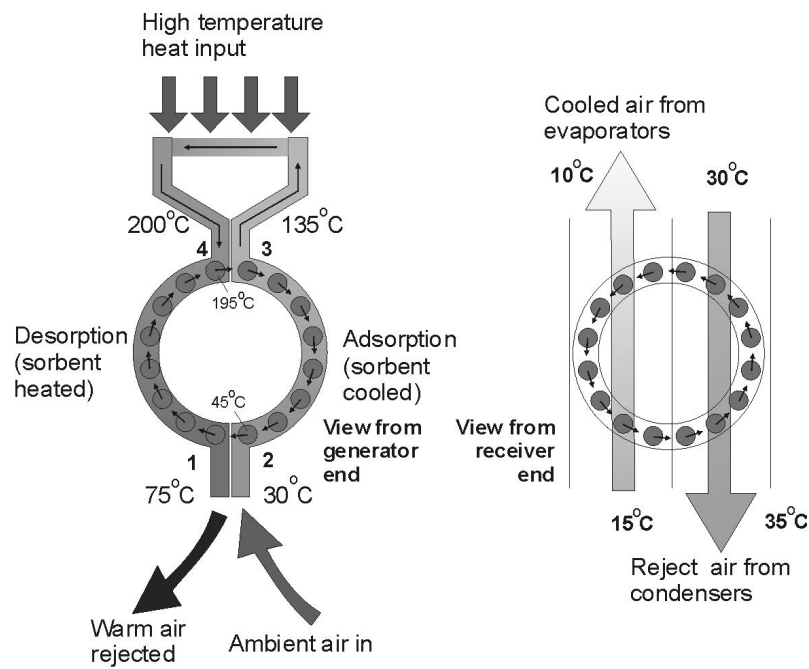


Figure 3: Section through the generators.



Figure 4: Generator Section

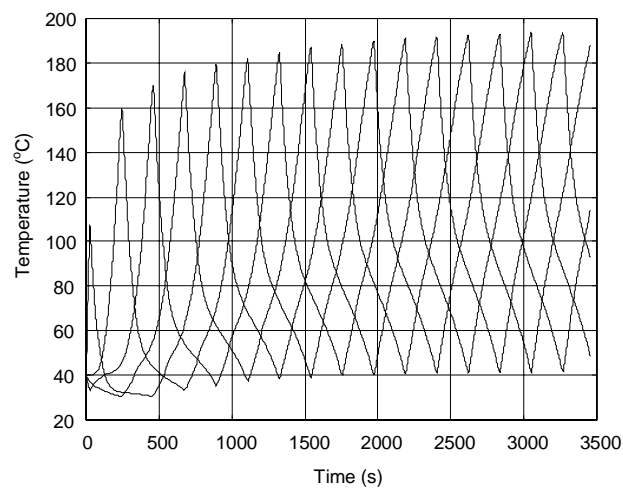


Figure 5: Module temperatures v. time

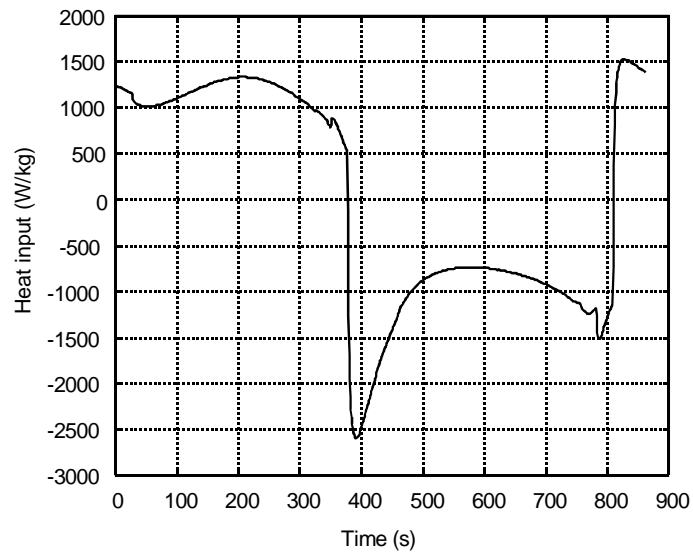


Figure 6: Specific heat input v. time

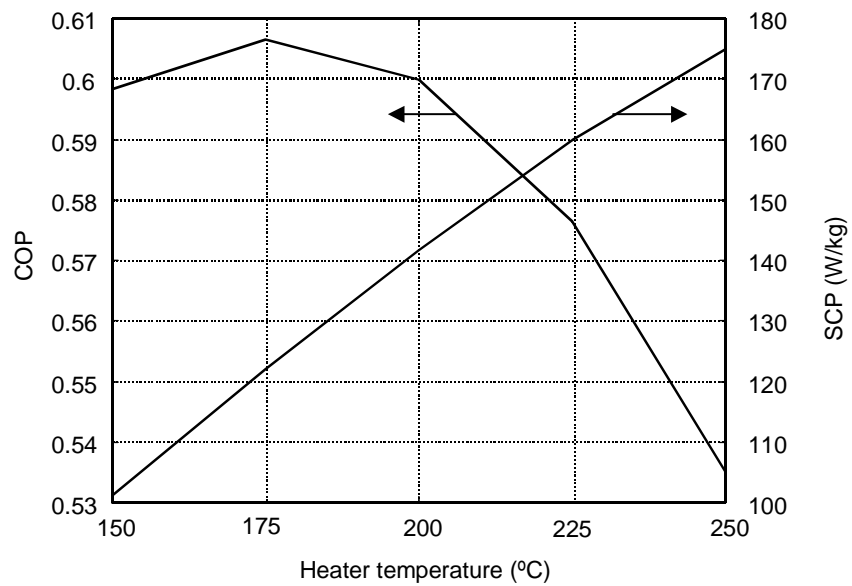


Figure 7: Performance v. Heater Temperature

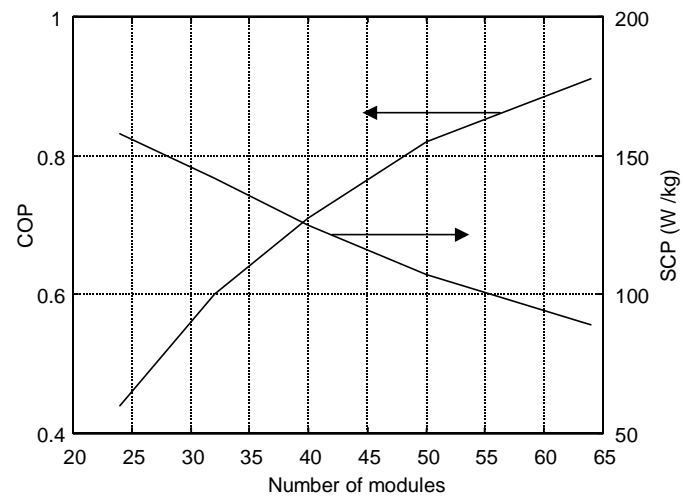


Figure 8: Performance v. Number of modules

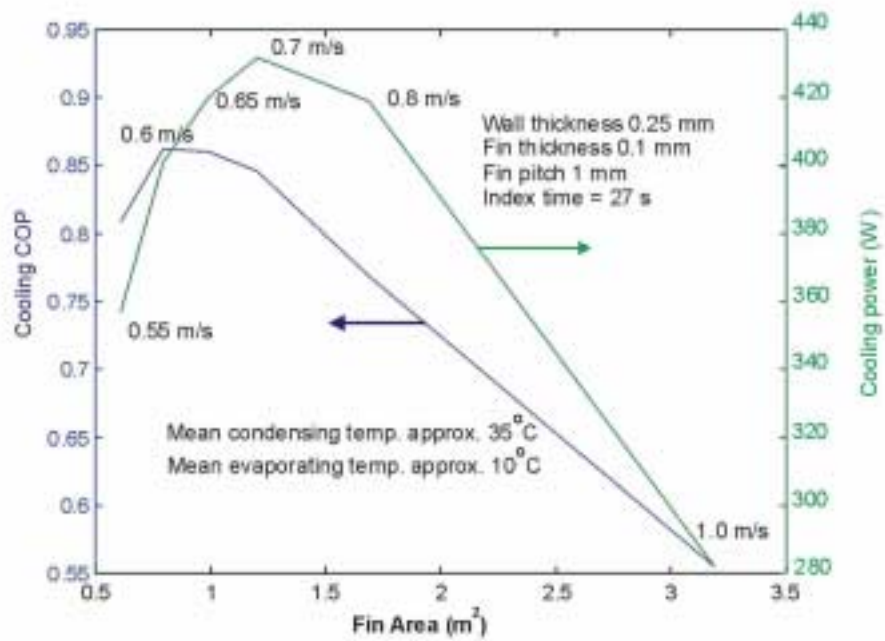


Figure 9. Improved design options

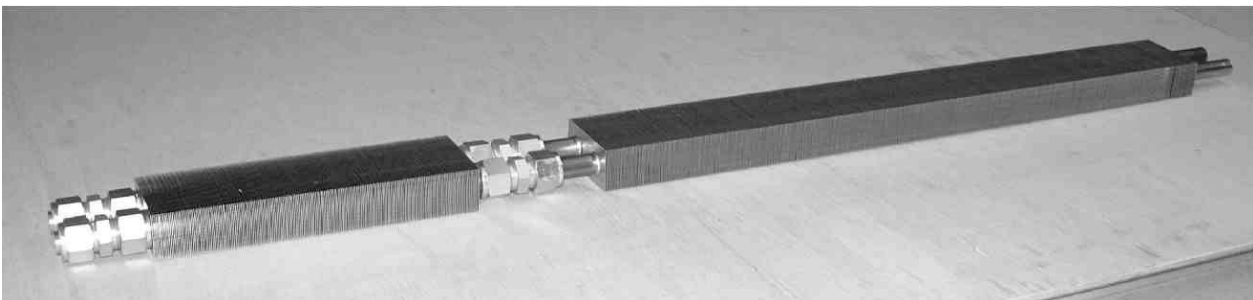


Figure 10. Double module

Table 1: Design and operating parameters of base case example

Parameter	Value
Number of modules in desorption zone	16
Number of modules in adsorption zone	16
Number of receivers adiabatic during desorption	3
Number of receivers adiabatic during adsorption	3
Generator length	1 m
Generator diameter	12.7 mm
Generator finning	Aluminium, 3 mm pitch, 25.4 mm square.
Generator duct air velocity	1.0 m s <sup>-1</sup>
Air heater outlet temperature	200°C
Generator air inlet temperature	30°C
Condenser air inlet temperature	30°C
Evaporator air inlet temperature	15°C
Time for one complete revolution or cycle	864 s

Table 2: Base case performance indicators

Performance Indicator	Value
COP cooling	0.60
COP heating	1.52
Cooling power	291 W
SCP	142 W kg <sup>-1</sup>
Mean temperature of air entering heater	170 °C
Mean temperature of air leaving desorption zone	51 °C
Mean condensing temperature	38 °C
Mean evaporating temperature	8.9 °C

Table 3: Parametric study results

Parameter	Base Case Value	New Value	COP (cooling)	SCP (W kg <sup>-1</sup> )	T <sub>ads out</sub> (°C)	T <sub>des out</sub> (°C)	T <sub>ev out</sub> (°C)	T <sub>con out</sub> (°C)	T <sub>ev mean</sub> (°C)	T <sub>con mean</sub> (°C)
Air speed (m s <sup>-1</sup> )	1.0	1.1	0.56	176	164	59	9.7	36.4	8.0	38.5
		0.9	0.57	110	173	48	10.8	36.1	9.2	38.1
Heater temp. (°C)	200	250	0.54	175	209	60	9.8	37.3	8.0	39.4
		225	0.58	160	190	55	9.8	36.6	8.1	38.3
		175	0.61	121	150	48	10.7	35.8	9.3	37.6
		150	0.60	101	129	45	11.5	34.7	10.2	36.2
<i>h<sub>generator</sub></i>	120	60	0.54	139	167	55	10.5	36.0	9.0	37.8
		180	0.61	142	171	50	10.4	36.3	8.8	38.1
Evaporator air in (°C)	15	20	0.69	159	171	50	15.2	36.9	13.7	38.8
		10	0.52	127	169	52	5.6	35.7	4.1	37.3
Number of modules	32	24	0.44	158	166	56	9.5	36.9	7.4	39.0
		40	0.71	125	173	48	11.1	35.7	9.9	37.2
		50	0.82	107	174	45	11.8	35.0	10.8	36.4
		64	0.91	89	176	43	12.3	34.1	12.3	34.2
Base Case			0.60	142	170	51	10.4	36.2	8.9	38.1